


GREENSTONE (USA), INC. 971 Corporate Way, Fremont, CA 94539, USA Toll Free: 877-206-5021, Fax: (510) 683-9313 jamal@greenstoneusa.com www.greenstoneusa.com

Vacuum Interrupter for Circuit-Breaker

GTD-24/1600-25A



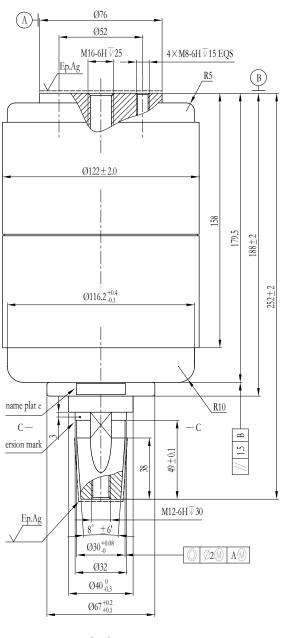

Main Technical Data		
ltem	Unit	Value
Rated Voltage	kV	24
Lightning Impulse Withstand Voltage (Peak)	kV	125☆
Short-time (1min) Power-frequency Withstand Voltage	kV	42/65☆
Rated Frequency	Hz	60
Rated Current	А	1600
Rated Short-time Withstand Current	kA	25
Rated Duration of Short-circuit	S	4
Rated Peak Withstand Current	kA	63
Rated Short-circuit Making Current	kA	63
Rated Short-circuit Breaking Current	kA	25
Max. Dc Component		40%
Switch Operations of Rated Short-circuit Breaking Current	Operations	30
Rated Single Capacitor Bank Breaking Current	А	400※
Rated Back-to-Back Capacitor Bank Breaking Current	А	400※
Mechanical Endurance	Operations	10000
Clearance Between Open Contacts	mm	13±1
Contact Closed Force Due to Bellows and Atmosphere	N	110±40
Counterforce of Contact at Full Stroke	N	210±40
Circuit Resistance at Min. Rated Contact Force	μΩ	≤25
Contact Limit Erosion	mm	3
Mass of Moving Parts	kg	1.65
Internal Gas Pressure	Ра	<1.33×10 ⁻³
Shelf Life	Years	20
Rated Operating Sequence	Open-0.3s-CO-180s-CO	

Mechanical Data of Switch Equipped With Interrupter

ltem	Unit	Value
Average Opening Speed (first 6mm)	m/s	1.4±0.2
Average Closing Speed (last 6mm)	m/s	0.8±0.2
Contact Bounce Duration at Closing Operation	ms	≤2
Out of Simultaneity of Contact Closing and Opening	ms	≤1
Rated Contact Pressure	N	2900 +400
Contact Pressure at Contact Touch Point	N	2000 +150
Max. Rebound of Contact at Opening Operation	mm	2
Overtravel During Opening	mm	≤2

Note 1: "* Within transformer oil or equivalent isolation medium;

Note 2: "X" Rated characteristics to be given on request;

Note 3: Meets or exceeds the electrical endurance requirements of class E2 for autoreclosing duty per IEC 62271-100;

Note 4: The movable stem of the vacuum interrupter could noly suffe on more than 25N · m twisting force and in order not to damage the metal bellows, the movable stem should be prevent from rotation when assembling. For more requirements please check the Instructions of Usage.